


PRIMARY AIR
INLET SIZE



For optimum control accuracy, a straight section of duct at least 1.5 duct diameters long and the same diameter as the inlet collar should be installed upstream of the terminal inlet. Sizes 6 through 22 utilize FlowStar™ multi-axis center averaging sensor; * Sizes 4 and 5 utilize single-axis, linear averaging multi-point sensor resulting in a different line slope as shown above.

TITLE: ΔP vs CFM @ INLET
FOR MODELS SDR, SGX, DDR, CFR, CFRQ, & VFR
WITH ENVIRO-TEC® SERIES 7000 ANALOG ELECTRONIC CONTROLS

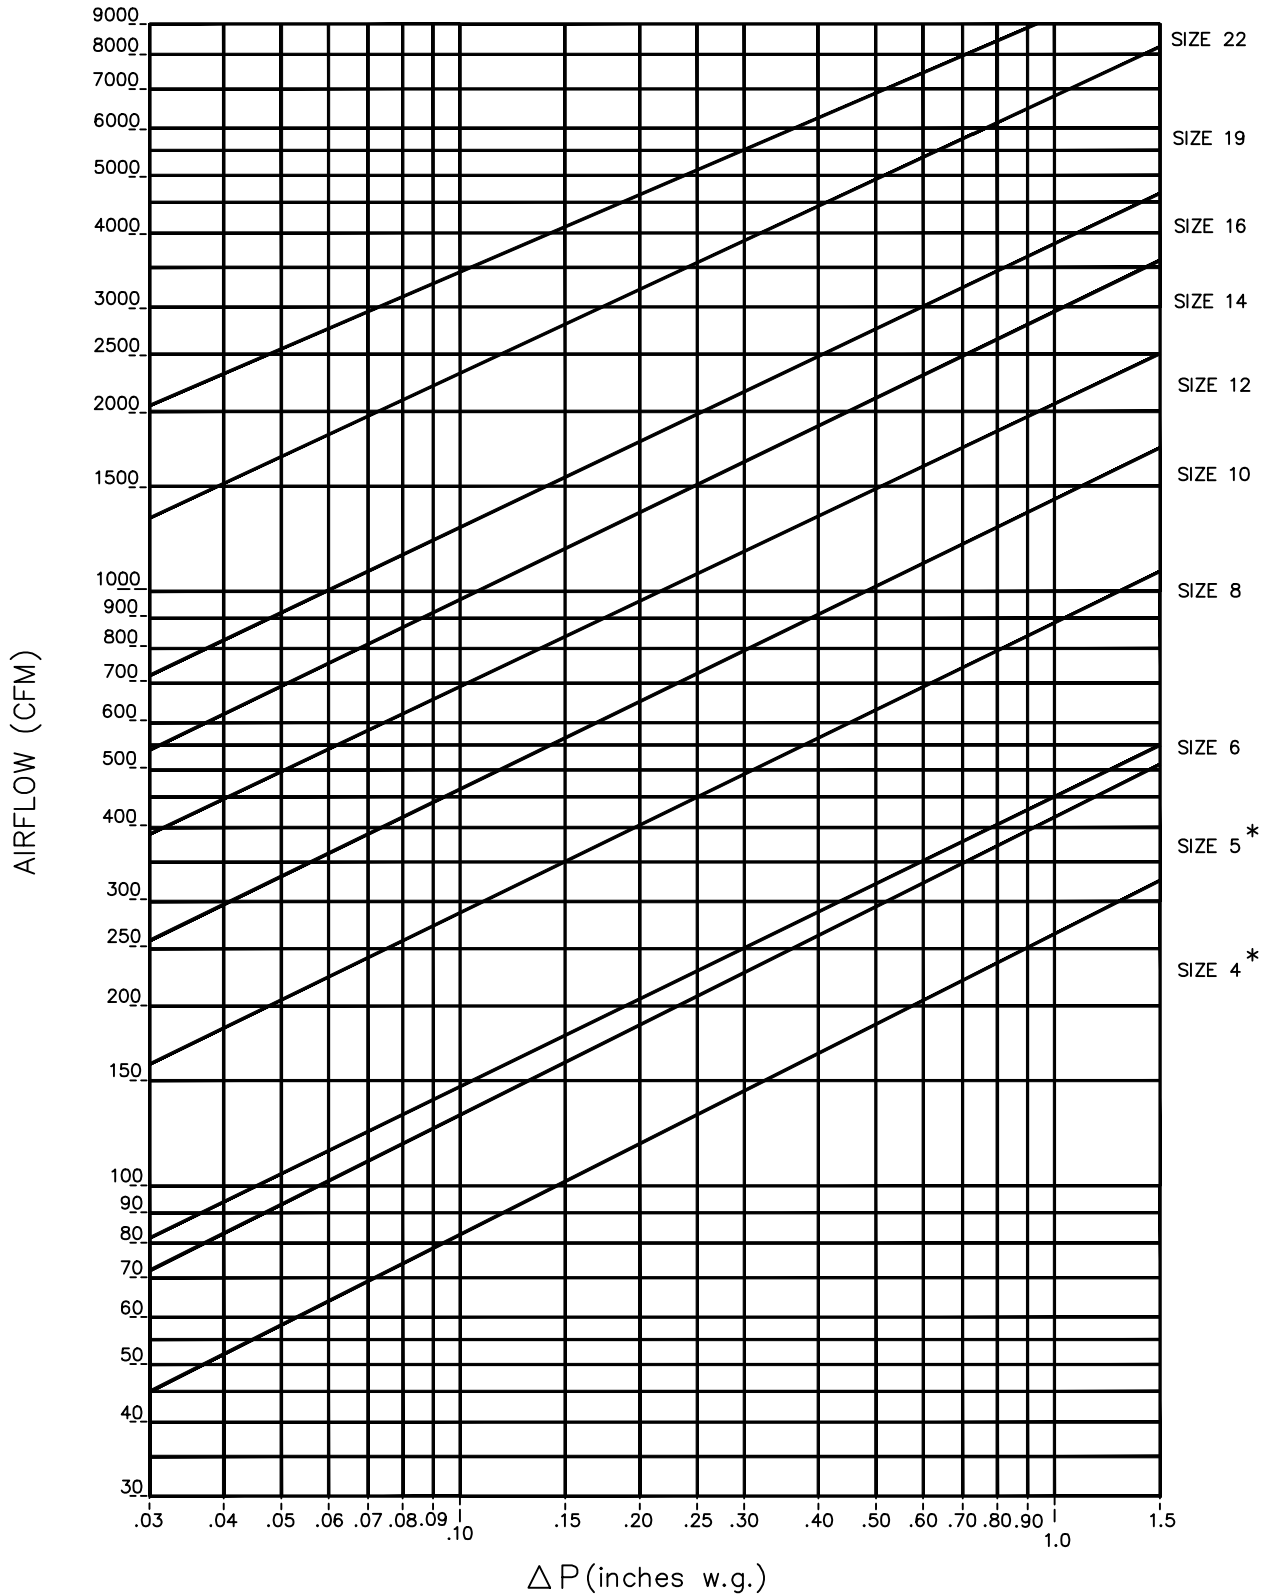

ENVIRO-TEC®

DRN BY: DVG	DATE: 06/02/08	SCALE: N/A	DRAWING NO.
CKD BY: DB	DATE: 07/31/15	REV: 04	

THIS DRAWING CONTAINS PROPRIETARY DATA. UNAUTHORIZED DISCLOSURE, REPRODUCTION, OR USE IS STRICTLY PROHIBITED WITHOUT WRITTEN PERMISSION.

DO NOT SCALE DRAWING
DIMENSIONS AND DATA ARE SUBJECT TO CHANGE WITHOUT NOTICE.
CONTACT FACTORY FOR CERTIFIED DRAWINGS.

15883